#### Prüfinstitut Hoch

Lerchenweg 1 D-97650 Fladungen Tel.: int - 49 - 9778-7480-200 hoch.fladungen@t-online.de

www.reaction-to-fire.de



Test laboratory for the fire behavior of building materials, Dipl.-Ing. (FH) Andreas Hoch Testing, supervising and certifying body, authorized by the building supervision authority

# TEST REPORT PZ-Hoch-160551

for the proof of Fire behaviour according to DIN 4102, part 1 Translation of the German test report – no guarantee for translation of technical terms

company

Junkers & Müllers GmbH

Bolksbuscher Straße 27 D-41239 Mönchengladbach

description of samples

-fabric consisting of polyester, with polymer coating on one side-

colour: white

name of the material

"TT MEDIATEX JM-AIR FR"

sampling

by the company itself

content of request

Proof of flammability to classify building materials to class B1

"schwerentflammbar" according to DIN 4102, part 1

validity of test report

30.04.2021

result

The examined product meets the requirements of class B1 for "schwerentflammbare" (hardly flammable) building materials according to DIN 4102, part 1 (May 1998), suspended freely or with distance of >40 mm to same or other plain materials.

This test report includes 4 pages and 4 enclosures.

Remark: If the above mentioned building material is not used as product according to MBO § 2, Abs. 9, Ziffer1, there is no need for a general building supervisory test report.

This test report is not valid if the examined building material is used as product in the meaning of state building prescriptions (MBO § 17, Abs. 3).

This test report does not replace an eventually necessary proof of applicability concerning building supervisory or building laws in the meaning of state building prescriptions. This has to be verified by:


- "allgemeine bauaufsichtliche Zulassung" (general building inspectorate approval ) or by "allgemeines bauaufsichtliches Prüfzeugnis" (general building inspectorate certificate) or by "Zustimmung im Einzelfall" (exceptional approval)

This test report can underlie building supervisory procedures

for regular building products for the prescribed proofs of conformity

for non regular building products for the needed proofs of applicability.

This test report must not be published and copied without preceding agreement of the test laboratory and if agreed, only during validity and unchanged concerning appearance and contents.





### 1. Description of test material in condition as delivered

PN 23474: "TT MEDIATEX JM-AIR FR"

- fabric consisting of polyester, with polymer coating on one side -

colour: white

side B: a little bit smoother surface

characteristic values determined by the test laboratory:

area weight: about 243 g/m²

thickness: about 0,36 mm

The testing laboratory is not provided with further details concerning composition of the tested building materials. Samples are deposited.

### 2. Preparation of samples

The samples were kept in climate chamber 23/50 until they reached constant weight.

#### 3. Arrangement of samples

mounting:

freely suspended

#7860:

flaming side A in weft direction flaming side B in weft direction

#7861: #7862:

flaming side A in warp direction

4. <u>Date of test</u> CW 21 in 2016

5. Results The test has been examined according to DIN 4102 (Mai 1998)

	Measurement	Res	ult with the	tested spe	cimen	Dim.
e e	Test number	#7860	#7861	#7862		
_	flaming direction / side	weft / A	weft / B	warp / A	34443	
1	Number of specimen arrangement acc. to. DIN 4102/T15, schedule 1	1	1	1		
2 3	Maximum flame height above bottom edge of the specimen Time 1)	<b>50</b> 0:15	60 0:25	<b>40</b> 0:05	1 Mario	cm min:s
4	Burn through / melting Time 1)	0:04	0:04	0:04	News	min:s
5	Observations on the back side of the specimen Flames / Glowing Time <sup>1)</sup> Change of color Time <sup>1)</sup>	./. ./. ./.	.I. .I. .I. .I.	.l. .l. .l.	.J. .J. .J. .J.	min:s
7 8 9	Falling of burning droplets Start 1) Extent sporatic falling of burning droplets 2) continuous falling of burning droplets 2)	.l. .l.	.1. .1. .1. .1.	.J. J. .J.	J. J. J.	min:s
10	Falling of burning droplets Start 1) Extent	J.	J.	J.	.l.,	min:s
11 12	sporatic falling of burning droplets <sup>2)</sup> continuous falling of burning droplets <sup>2)</sup>	J.	J.	./.	./.	

	Measurement	Res	Dim.			
آة 5	Test number	#7860	#7861	#7862		
	flaming direction / side	weft / A	weft / B	warp / A	***	
13	Afterflame time at the bottom of the sieve (max.)	.I.	/.	./.	./.	min:s
14	Impairment of the burner by dropping or falling material: Time 1)	$J_{\tilde{x}}$	J	o.J.c		min:s
15 16	Premature end of test Final occurance of burning at the specimen 1) Time of suprtually and of test 1)	$J_{e}$	J.	.l.	.1,	min:s
10	Time of eventually end of test 1)	.1.	.J.	.1.	./	min:s
17 18 19 20 21	Afterflame after end of test Time 1) Number of specimen Front side of specimen 2) Back side of specimen 2) flame length	J. J. J. J. J.	./. ./. ./. ./.	.1. .1. .1. .1.	.1. .1. .1. .1. .1.	min:s
22 23 24 25 26	Afterglow after end of test Time 1) Number of specimen Place of appearance Lower half of the specimen 2) Upper half of the specimen 2) Front side of specimen 2)	J., J., J., J., J., J.,	./. ./. ./. ./. ./. ./.	./. ./. ./. ./. ./. ./.	.I. .I. .I. .I. .I. .I.	min:s
27 28 29 30	Back side of specimen <sup>2)</sup> Density of smoke  ≤ 400 % * min  > 400 % * min <sup>4)</sup> Diagram: encl. no.	./. 19 ./. 1	./. 24 ./. 2	./. 10 ./. 3	./. ./.	% * min % * min
31	Residual lengths: individual value <sup>3)</sup> Specimen 1 Specimen 2 Specimen 3 Specimen 4	57 55 49 63	57 43 68 63	63 64 67 63		cm cm cm cm
32	Average value, individual test 3)	56	58	64		
33	Photo of specimen in enclosure no.	1	2	3		
34 35	Flue gas temperature Maximum of average value	121 09:51	123 09:39	115 09:57		°C min:s
36	Time <sup>1)</sup> Diagram: encl. no.	1	2	3		
	Al .				1	
37	Remarks: - none -					

indication of times: from the begin of testing procedure
checked off if applicable
indication of carrier/foam layer separated in case of fire-proofing agents
very strong development of smoke

### 6. Explanations concerning the testing procedure

There were no additional tests proceeded because of the residual length of more than 45 cm.

## 7. Summary of results and additional establishments to Fire Behaviour

o,	measutement	ment Result with the tested specimen									
lineno.	test-no.	#7860 weft / A	#7861 weft / B	#7862 warp / A	(1112)	dimen					
1	residual length	56	58	64		cm					
2	max. smoke temperature	121	123	115		°C					
3	density of smoke - integral	19	24	10		%min					
4	remarks: -none-			11							

According to DIN 4102, part 1, "schwerentflammbare" (hardly flammable) building materials must meet the requirements of class B2.

Pursuant to additional tests in the ignitability apparatus this can be determined (appendix 4).

#### 8. Special remarks

- This report is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or grounds etc. the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions.
- This test report is not valid, as soon as the fabric is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, im particular private proprietary rights.
- For legal interests only the German original version is relevant.
- In General Building Inspectorates procedures this test report can be based for
  - o regular building materials for the required proof of accordance
  - o for not regular building materials for the required proof of applicability

#### 9. Validity

This test report is valid until the mentioned date on page 1. The test report becomes invalid in case the standards on which the tests are based are changed.

Fladungen, 31.05.2016

clerk in charge:


(Dipl.-Ing. (FH) Jürgen Hammer)

Head of the test laboratory:

(Dipl.-Ing.(FH) Andreas Hoch)






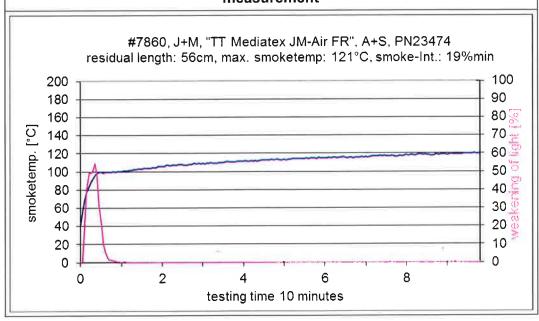



#### measurement #7861, J+M, "TT Mediatex JM-Air FR", B+S, PN23474 residual length: 58cm, max. smoketemp: 123°C, smoke-Int.: 24%min 80 🐺 smoketemp. [°C] testing time 10 minutes



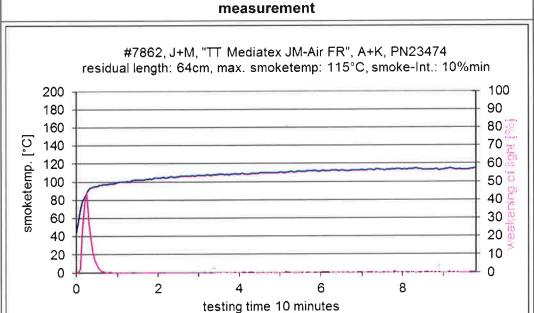

# Test for normal flammability classifying B2 according to DIN 4102

- 1. <u>Description of test material in condition as delivered</u> look at page 2
- 2. Preparation of samples

Out of the material there have been cut samples for the ignitability apparatus. The samples were kept in a climate 23/50 until they reached constant weight.

3. Arrangement of samples -freely suspended-

Flaming in warp and weft direction / Flaming side A and side B

4. Date of test

CW 19 in 2016

5. Results

PN 23474: flaming side B in weft		surface-test							edge-test						
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	툽		
ignition <sup>1)</sup>	3	3	2	2	3		1	-					s		
reaching the mark of measurement <sup>1)2)</sup>	.1,	$J_{\gamma}$	.1,	J.	$\mathcal{J}_{\varepsilon}$	***	J.	1	722	12	122		s		
max. flame height	11	11	11	10	11	-	10						cm		
time	12	10	12	9	11		14	***		-	-				
self cessation of the flames end of afterflame <sup>1)</sup>	15	15	15	15	15	==	15			1			s		
end of glowing <sup>1)</sup>	./.	$J_{r_{\rm S}}$	.J.	$J_{c}$	./2		$_{i}I_{i}$	- E					s		
flames were extinguished after <sup>1)</sup>	./.	./2	./.	Ja	./₃		s.L	-/-	-/			:( <del>**</del>	s		
smoke development (visual)		moderate-heavy moderate-heavy													
dropping of burning material during 20 s <sup>1)</sup>	.1.	$J_{2}$	./.	J.	./,		$J_{\epsilon}$	<b>3</b>			-	122	s		
Appearance after test: burned out till ma	ax. heiç	ght 12	cm x	width	2cm										

PN 23474: additional tests		•	edge-	test			surface-test						
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	틍
ignition <sup>1)</sup>	1	1	1		===		2	3	2	22			s
reaching the mark of measurement <sup>1)2)</sup>	.1=	:./s:	./.				./	J.	./.				s
max. flame height	8	8	10				8	10	10		N <del>TTT</del> -		cm
time	12	8	12				13	11	11			22	
self cessation of the flames end of afterflame <sup>1)</sup>	15	9	13		22	3 <b>22</b> 3	15	15	15		u <del>ne</del> :		s
end of glowing <sup>1)</sup>	./,	./.	J.		===		:da	./₃	.1	24			s
flames were extinguished after <sup>1)</sup>	./.	a./.	./.				.J.	$J_{\epsilon_1}$	. <i>I</i> ,				s
smoke development (visual)	moderate-heavy moderate-heavy												
dropping of burning material during 20 s <sup>1)</sup>	$J_{\tilde{s}}$	./.	./.				.L.	./.:	./		-		s

<sup>1)</sup> time mentioned from the beginning of the test 2) during 20 Sec -/- no appearance -- no information

6. Remarks and explanations to the testing procedure - none -

7. Opinion concerning the dropping of burning material

The test for normal flammability shows no burning dripping material.